



# TYPICAL METER PEDESTAL FOR CURRENT TRANSFORMER METER

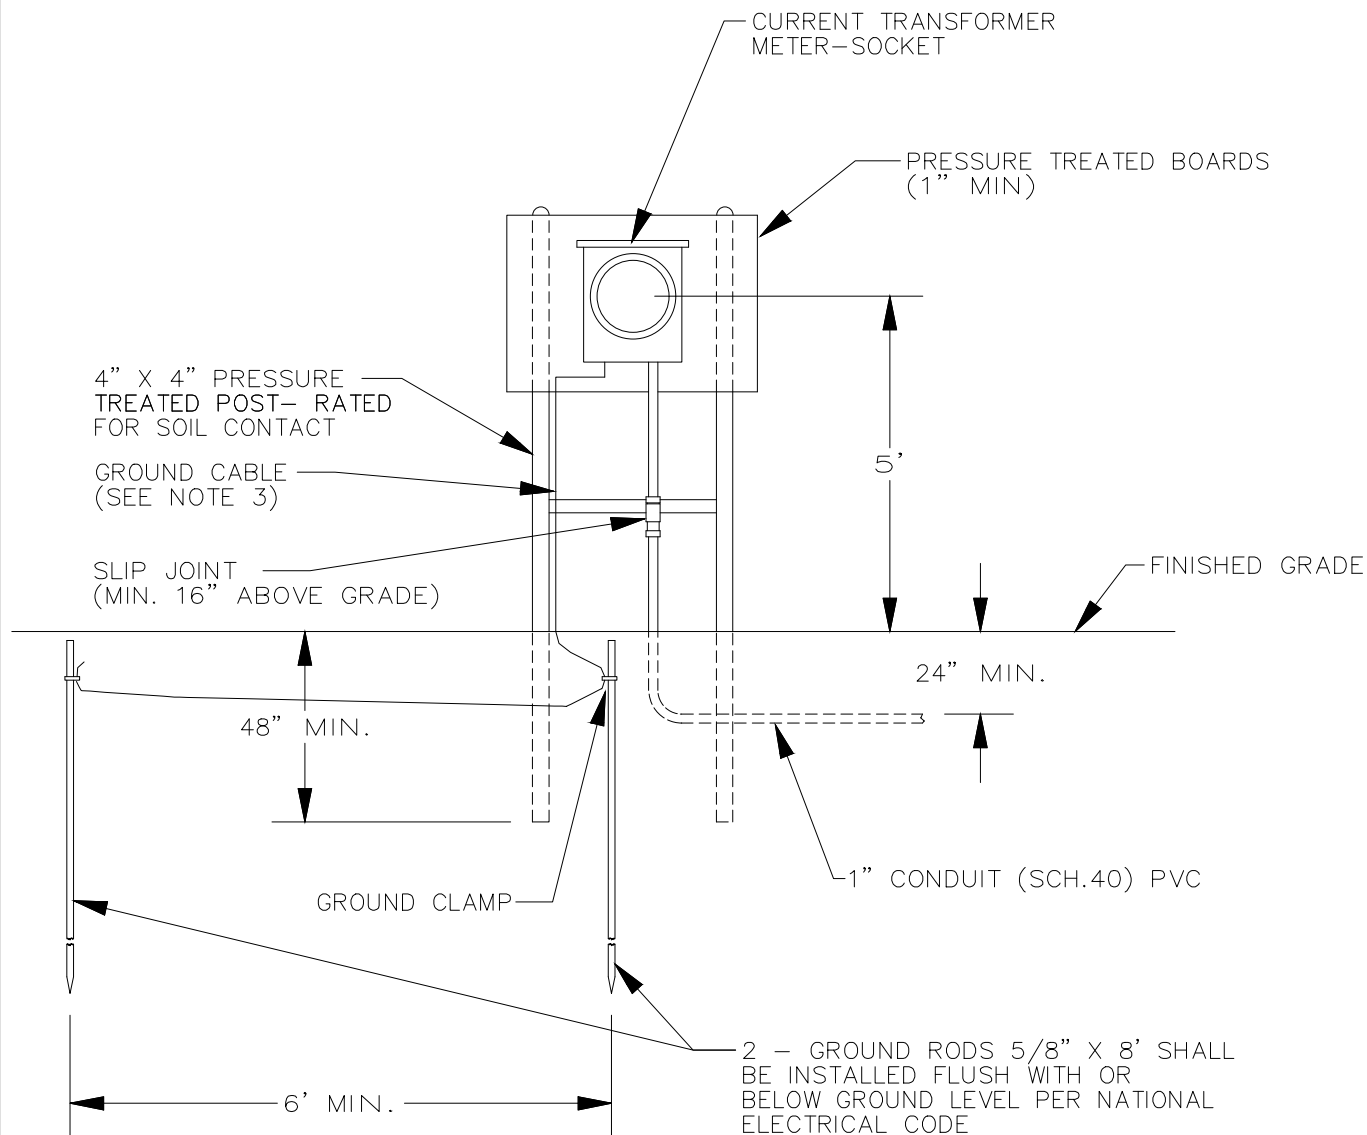

## NOTES:

1. Location of the pedestal will be designated by a VEC representative.
2. 4" X 4" pressure treated wood posts shall be rated for soil contact.
3. A minimum #6 copper ground cable must be connected in the meter socket, to its own ground terminal.
4. Pedestal shall be located a minimum of 10' from pole or pad mounted transformer.

						VERMONT ELECTRIC COOPERATIVE INC.	
						JOHNSON, VT	
						TYPICAL METER PEDESTAL FOR CURRENT TRANSFORMER METER	
						DWG. NO. 205 Page 1	
REV	DATE	REVISION DESCRIPTION	DRN	CKD	DES: CKD	DRN: CB	SCALE: NONE
					DATE: 07/10/2017	REV <u>1</u>	