SINGLE PHASE INSTALLATION

3 WIRE 1 PHASE & NETWORK

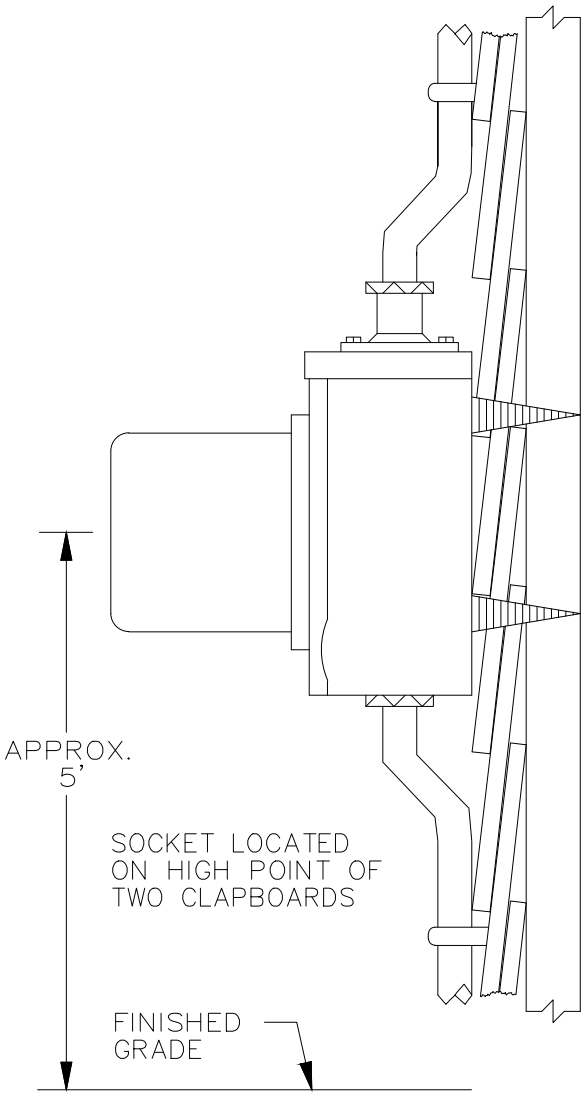

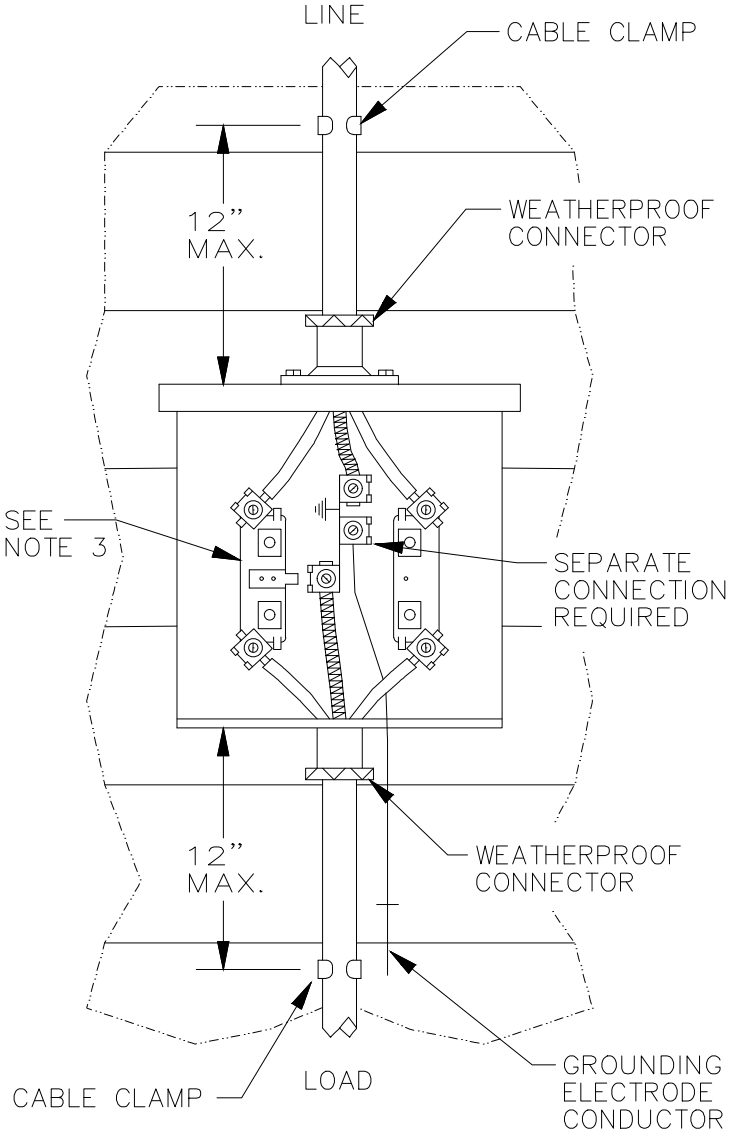

SOCKET MUST BE SET SO THAT
METER DISK IS LEVEL

NOTES:

1. ON RESIDENTIAL SERVICES, METER SOCKETS WITH AN AMPERE CAPACITY OF 200 AMPS OR ABOVE, SHALL BE EQUIPPED WITH MANUAL BYPASS AND SHIELDS FOR THE JAWS.
2. ON COMMERCIAL AND INDUSTRIAL SERVICES, ALL METER SOCKETS SHALL BE EQUIPPED WITH MANUAL BYPASSES AND SHIELDS FOR THE JAWS.
3. FIFTH TERMINAL MUST BE INSTALLED AT 9 O'CLOCK POSITION FOR NETWORK AND CONNECTED TO NEUTRAL. WITH VEC PERMISSION 6 O'CLOCK POSITION MAY OCCASIONALLY BE ALLOWED.

REV	DATE	REVISION DESCRIPTION	DRN	CKD

VERMONT ELECTRIC CO OP INC — the co op advantage — energy smart today

DES: | DRN: CB
CKD: | SCALE: NONE
DATE: 07/10/2017

VERMONT ELECTRIC COOPERATIVE INC.

JOHNSON, VT

SINGLE PHASE INSTALLATION
3 WIRE 1 PHASE & NETWORK

DWG. NO. 602 PAGE 1

REV 1